


REMOVE THESE WIRES FROM THE CONTACTOR TO THE POWER SUPPLY AND SAVE TO USE WHEN REPLACEMENT BOARD ARRIVES

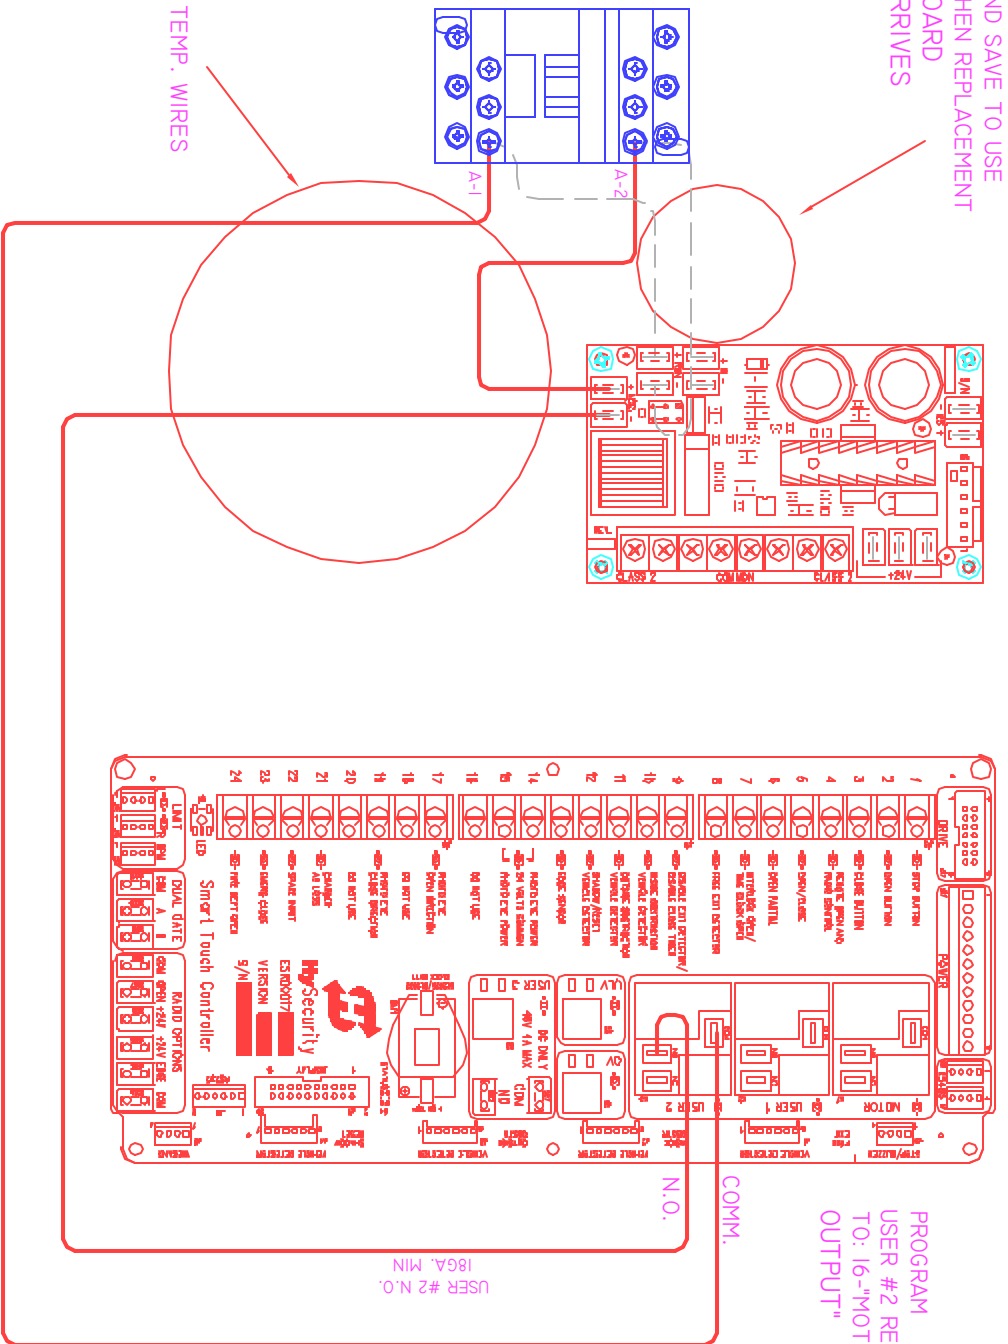

HySecurity
 HySecurity Inc. 6623 South 228th St. Kent, Wa. 98032-1876

DESCRIPTION
MOTOR RELAY BY-PASS

ECN NO: D0018	REV	CHANGE DESCRIPTION	REV BY	REV DATE	PART NO:	SHEET 1 OF 1
------------------	-----	--------------------	--------	----------	----------	--------------